
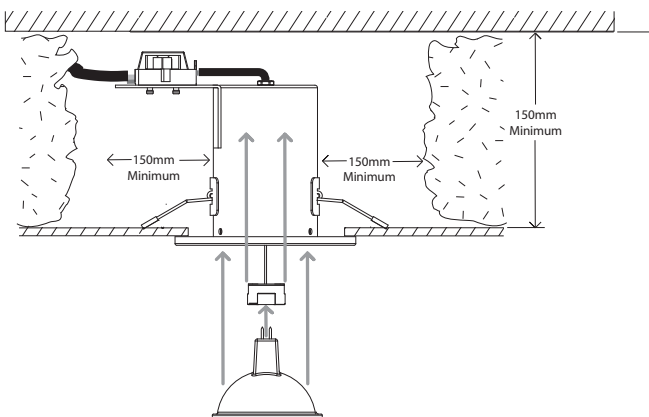
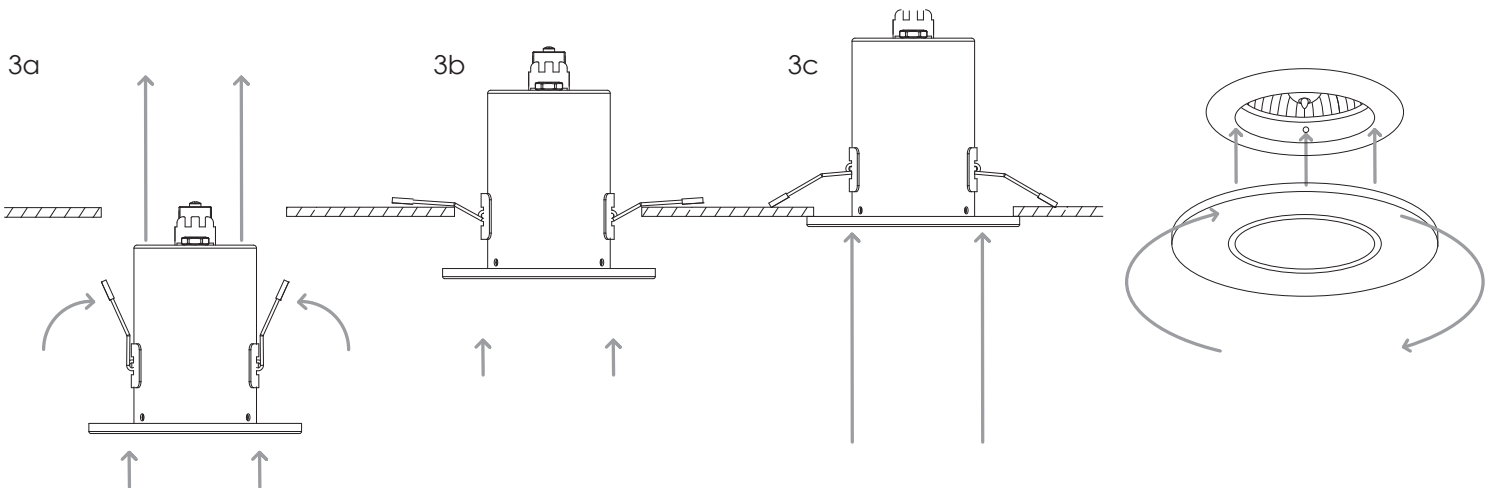


Please read all instructions carefully before commencing assembly.
These light fittings conform to BS EN 60598

Shower Downlights, These can be used in Bathroom Zones 1, 2 & 3
For ceiling use only (Rated IP65 Sprayproof)

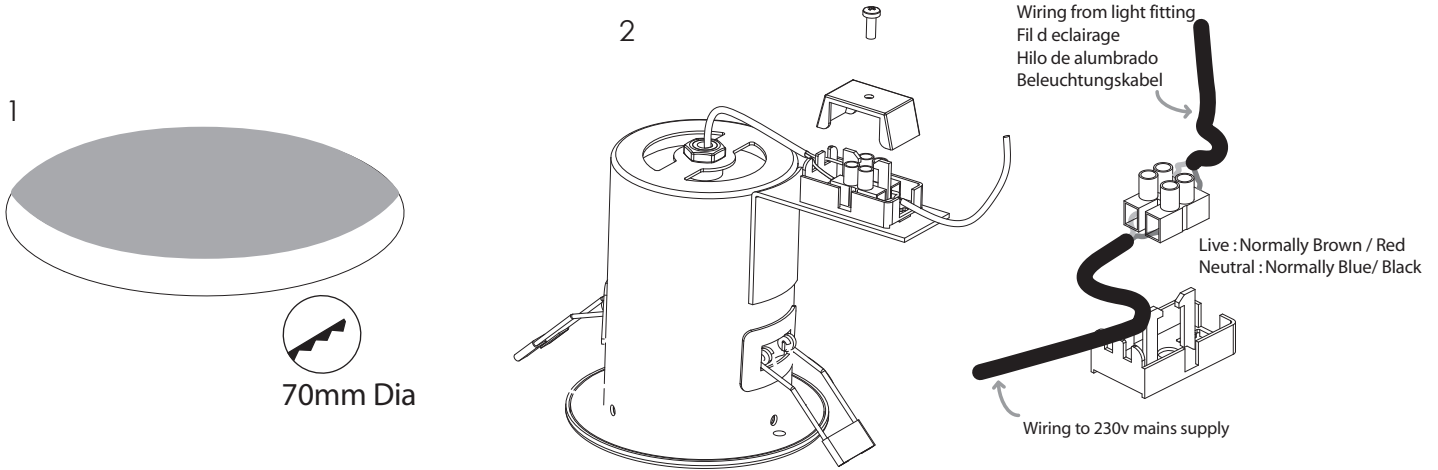

	<p>Not suitable for covering with thermal insulation. Nicht für die Abdeckung mit Wärmedämmung geeignet Ne peut être recouvert de matériaux d'isolation No apto para cubiertas con aislamiento térmico.</p>
--	---

	<p>Not suitable for mounting in flammable materials, eg wood Nicht für das Anbringen in flammbar Material geeignet Ne convient pas pour montage dans des matériaux inflammables. No apto para el montaje dentro de materiales inflamables.</p>
--	--

Astro Lighting downlighters are suitable for installation in gypsum wall board ceilings to timber floors that require up to 90min fire resistance to BS 476 : Part 21 : 1987 or BS EN 1365-2 : 2000.

The specifier must check with the board manufacturer that the ceiling and floor system without downlighters will achieve the required fire resistance period + 10%.